



The Dayton Power and Light Company
1900 Dryden Road
Dayton, Ohio 45439

November 21, 2019

Chairman Sam Randazzo
Ohio Power Siting Board
180 East Broad Street
Columbus, Ohio 43215-3793

**RE: In the Matter of the Letter of Notification Application of The Dayton Power and Light Company
for a Certificate of Environmental Compatibility and Public Need for the Clay Substation Project
PUCO Case No. 19-1822-EL-BLN
Proof of Compliance with Ohio Administrative Code 4906-6-08**

Dear Chairman Randazzo,

The Dayton Power and Light Company ("DP&L") hereby files this proof of compliance with the notice requirements set forth in Rules 4906-6-08 of the Ohio Administrative Code for the above-referenced project application:

1. In accordance with OAC 4906-6-08(A), DP&L published public notices of the Letter of Notification in newspapers of general circulation in the project's area on November 14, 2019 and November 16, 2019.
2. In accordance with OAC 4906-6-08(B), DP&L mailed a letter describing the project to each property owner and affected tenant via first class mail on November 8, 2019.

Respectfully submitted,

ss:/ *Randall V. Griffin*

Randall V Griffin (Ohio Bar No. 0080499)
Chief Regulatory Counsel
The Dayton Power and Light Company
937-259-7221
Randall.griffin@aes.com

Cc: Ashton Holderbaum, OPSB Staff

APPENDIX A

Public Notification to Contiguous Land Owners/Tenants

APPENDIX A

Property Owners Affected by the Dayton Power and Light – Clay Substation Project

Case No. 19-1822-EL-BLN

Property Owners

Parcel ID	Parcel Address	Owner Name	Owner Address
05-23-000-246.00	2221 N. Gath Rd	Carraher Farms Partnership	2455 Stringtown Rd, Sardinia, OH 45171
05-23-000-244.00	N. Gath Rd	Carraher Farms Partnership	2455 Stringtown Rd, Sardinia, OH 45171
05-23-000-245.00	N. Gath Rd	Carraher Farms Partnership	2455 Stringtown Rd, Sardinia, OH 45171
05-23-000-258.00	N. Gath Rd	Winkle, Nelson	1440 Parrot Ln, Sardinia, OH 45171
05-23-000-246.02	2221 N. Gath Rd	Kiley, David A	2221 N. Gath Rd, Sardinia, OH 45171
05-23-000-246.01	2320 N. Gath Rd	Dunseith, James R	2320 N. Gath Rd, Sardinia, OH 45171
05-23-000-256.00	2320 N. Gath Rd	Dunseith, James R	2320 N. Gath Rd, Sardinia, OH 45171
05-23-000-251.00	N. Gath Rd	AMC Farms LLC	PO Box 985 Waynesville, OH 45068



The Dayton Power and Light Company
1900 Dryden Road
Dayton, Ohio 45439

<<DATE>>

<<LANDOWNER>>

<<ADDRESS>>

<<CITY>>, <<STATE>> <<ZIP>>

Re: **Letter of Notification**
Dayton Power and Light - Clay Substation Project
PUCO Case Number 19-1822-EL-BLN

Dear <<ADDRESSEE>>:

You are receiving this letter because public records indicate that you own or live near a proposed electrical project. The Dayton Power and Light Company (DP&L) is in the process of obtaining approval from the Ohio Power Siting Board (OPSB) for the Clay Substation Project (Project) located in Clay Township, Highland County, Ohio. The Dayton Power and Light Company plans to build a new 345 kV substation off North Gath Road. The attached map shows the location of the project area. Construction is expected to start in March 2020 and be completed by September 30, 2020.

In accordance with Ohio Administrative Code (OAC) Rule 4906-6-05, this Project falls within the OPSB's requirements for a Letter of Notification (LON) Application. These rules also require the applicant to provide potentially affected property owners with notice of the Project and that the LON Application is pending before the OPSB. The Project has been assigned Case Number 19-1822-EL-BLN. Therefore, this letter is being sent to you, in compliance with OAC Rule 4906-6-05, to inform you of the Project.

The LON Application contains a description of the Project, and can be viewed at the following location:

- Hillsboro Public Library, 10 Willetsville Pike, Hillsboro, Ohio 4513


A copy of the Application is also available for public inspection at the offices of the OPSB, c/o Public Utilities Commission of Ohio, Utilities Department, 12th Floor, Borden Building, 180 East Broad Street, Columbus, Ohio 43215-3793, or on the website of the OPSB: <https://www.opsb.ohio.gov/>. To view an electronic version of the application, search Case Number 19-1631-EL-BLN. In addition, DP&L maintains a website (<https://www.dpandl.com/About-DPL/Reliability/Transmission-Improvements/>), which provides the public information about the Project and how to request a copy of the LON.

In accordance with OAC Rule 4906-6-08(A)(6), please be advised that interested persons may file motions to intervene and/or file comments with the OPSB within 10 days of the date of the publication of the public notice of the filing of this Project with the OPSB, as required by OAC Rule 4906-2-12, or later if good cause is shown. Petitions to intervene and comments should be addressed to the Ohio Power Siting Board, 180 East Broad Street, Columbus, Ohio 43215-3793 and reference Case No. 19-1822-EL-BLN.

Please contact Scott Teeters at 937-331-4314 or by email at dpltransmissionmaintenancegroup@aes.com if you have any questions about the project.



DP&L

Sincerely,

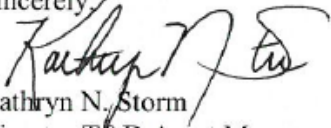A handwritten signature in black ink, appearing to read 'Kathryn N. Storm', written over the printed name.


Kathryn N. Storm

Director T&D Asset Management, AES U.S. Utilities Operations

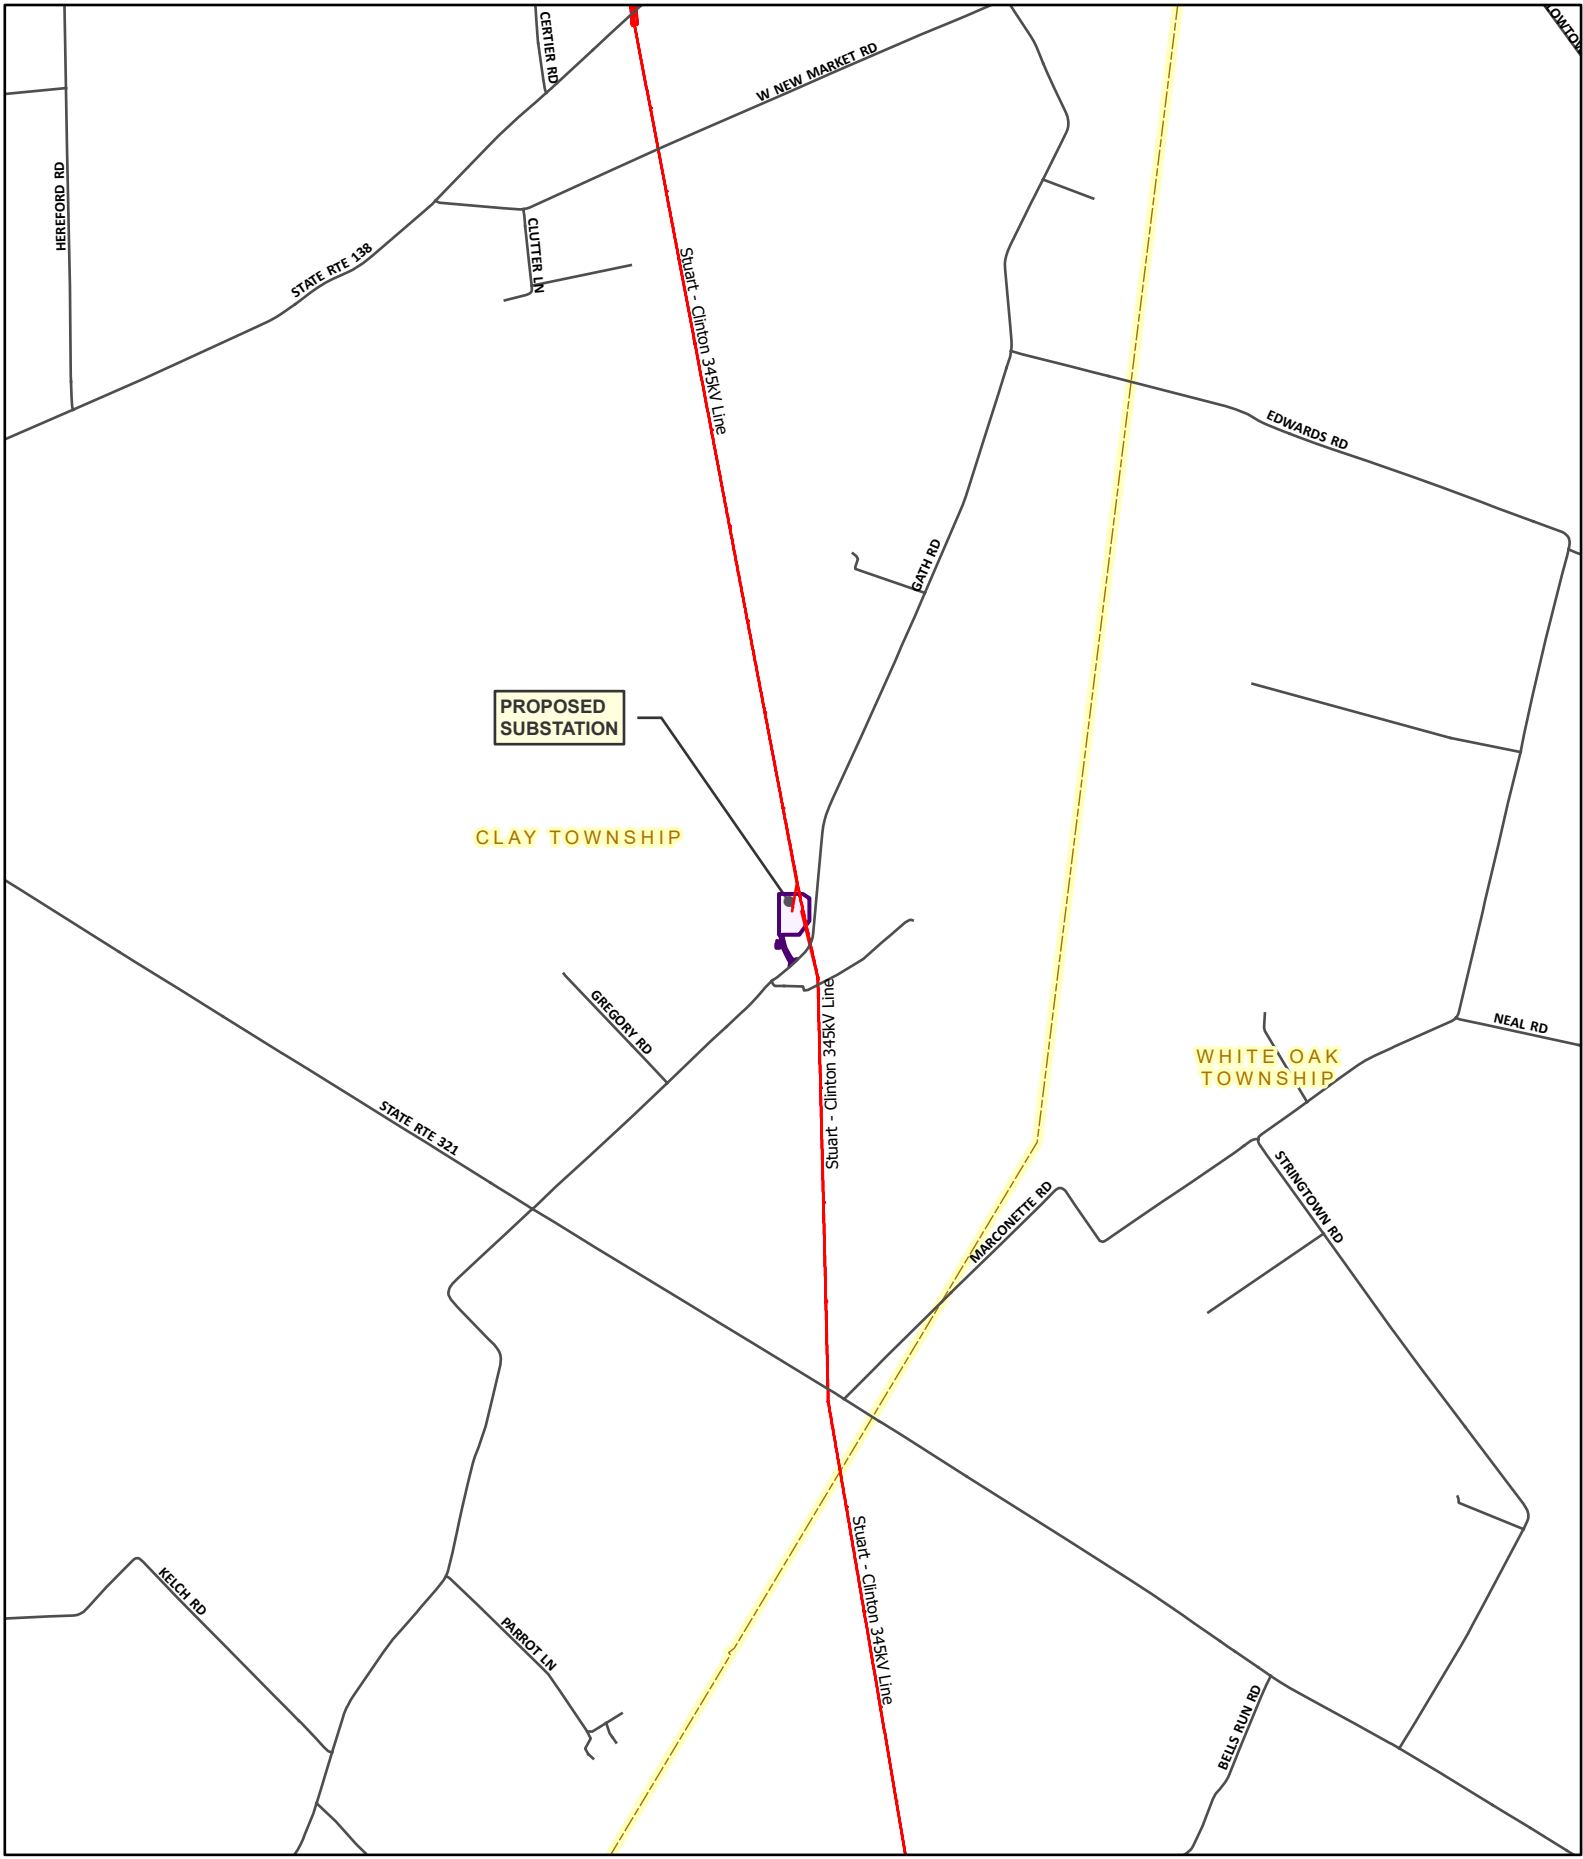

DAYTON POWER & LIGHT CLAY SUBSTATION PROJECT

- Existing Transmission Line
- Road
- Township Boundary
- Proposed Substation



Notice of Proposed Major Utility Facility

The Dayton Power and Light Company (DPL) is in the process of obtaining approval from the Ohio Power Siting Board (OPSB) for the Clay Substation Project located in Clay Township, Highland County, Ohio. DPL plans to build a new 345 kilovolt (kV) substation off North Gath Road. The Project involves tapping the existing 345 kV transmission line from the Stuart Substation to the Clinton Substation and building a new greenfield 345 kV three breaker ring bus for the purpose of interconnecting a new solar generator. Construction is expected to start in March 2020 and be completed by September 30, 2020.

The following public officials and agency departments have been provided a copy of the LON Application:


- Chris Fauber, Highland County Engineer
- Jeff Duncan, County Commissioner
- Terry Britton, County Commissioner
- Gary Abernathy, County Commissioner
- Highland County Planning Commission
- Pam Bushelman, District Operations Manager, County Soil & Water Conservation District
- William Brett Glover, Township Trustee
- Kenneth L. Bohl, Township Trustee
- James Massey, Township Trustee
- Patricia Winkle, Township Trustee

The Application is available for public inspection at the Hillsboro Public Library, 10 Willettsville Pike, Hillsboro, OH 45133; and at the Ohio Power Siting Board, 180 East Broad Street, Columbus, Ohio 43215. The OPSB phone number is 1-866-270-6772 and their general email address is contactopsb@puc.state.oh.us. An electronic version of the Application can be found on the OPSB website, <https://www.opsb.ohio.gov/>, by searching Case Number 19-1822-EL-BLN. Project information and how to request a copy of the Application can be found on DPL's website:

<https://www.dpandl.com/About-DPL/Reliability/Transmission-Improvements/>.

The Project has been assigned Case number 1822-EL-BLN and the LON to construct, operate, and maintain the Project is now pending before the OPSB.

In accordance with OAC Rule 4906-6-08(A)(6), please be advised that interested persons may file motions to intervene and/or file comments with the OPSB within 10 days of the date of the publication of the public notice of the filing of this Project with the OPSB, as required by OAC Rule 4906-2-12, or later if good cause is shown. Petitions to intervene and comments should be addressed to the Ohio Power Siting Board, 180 East Broad Street, Columbus, Ohio 43215-3793 and reference Case No. 19-1822-EL-BLN. Please contact Scott Teeters at 937-331-4314 or by email at dpltransmissionmaintenance-group@aes.com if you have any questions about the project.

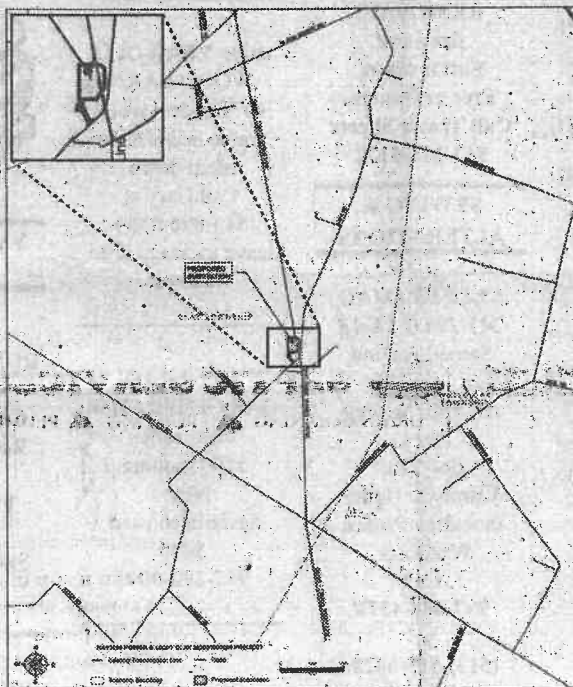

The State of Ohio
Brown County, ss:

Personally appeared before me, the undersigned authority, within and for said County, DIANNA FISCHER, Chief Financial Officer.

The News Democrat

a weekly newspaper published and of general circulation in said County, and made oath that the annexed advertisement was published in said newspaper once a week for 1 consecutive numbers, commencing on the 14 day of NOV, A.D., 2019 and that each insertion was upon the same day of each week, viz: Thursday.

Dianna Fischer
Charges, \$ 262⁵⁰

Sworn to and described before me, this 14th day of November, A.D., 2019.

Anthony S. Adams
Notary Public, State of Ohio
My Commission Expires May 31, 2020

The Highland County
PRESS

The Highland County Press
128 S. High St., P.O. Box 849,
Hillsboro, Ohio 45133
Tel.: (937) 840-9490; Fx.: (937) 840-9492
E-mail: hcpres@cinci.rr.com
E-mail: roryryan@gmail.com

**State of Ohio,
County of Highland, ss:
The Highland County Press,
Proof of Publication**

The Highland County Press, a weekly newspaper published and of general circulation in Highland County, affirms that the following advertisement was published in said newspaper, once per week, for 1 week(s), commencing on (date) NOVEMBER 16TH 2019 and that each insertion was published on the same day of the week; i.e., Saturday.

The advertisement was published in full, as requested by the respective entity, at the cost of \$ 299²⁵. 1/4 PAGE FOR DAYTON POWER & LIGHT

Sworn to and described before me, on this date 11/18/19.

Rory Ryan, Publisher [Signature]

Michelle Parrott, Notary Public State of Ohio

My Commission expires March 17, 2020 Michelle J Parrott



Notice of Proposed Major Utility Facility

The Dayton Power and Light Company (DPL) is in the process of obtaining approval from the Ohio Power Siting Board (OPSB) for the Clay Substation Project located in Clay Township, Highland County, Ohio. DPL plans to build a new 345 kilovolt (kV) substation off North Gath Road. The Project involves tapping the existing 345 kV transmission line from the Stuart Substation to the Clinton Substation and building a new greenfield 345 kV three breaker ring bus for the purpose of interconnecting a new solar generator. Construction is expected to start in March 2020 and be completed by September 30, 2020.


The following public officials and agency departments have been provided a copy of the LON Application:

- Chris Fauber, Highland County Engineer
- Jeff Duncan, County Commissioner
- Terry Britton, County Commissioner
- Gary Abernathy, County Commissioner
- Highland County Planning Commission
- Pam Bushelman, District Operations Manager, County Soil & Water Conservation District
- William Brett Glover, Township Trustee
- Kenneth L. Bohl, Township Trustee
- James Massey, Township Trustee
- Patricia Winkle, Fiscal Officer

The Application is available for public inspection at the **Hillsboro Public Library**, 10 Willettsville Pike, Hillsboro, OH 45133; and at the **Ohio Power Siting Board**, 180 East Broad Street, Columbus, Ohio 43215. The OPSB phone number is 1-866-270-6772 and their general email address is contactopsb@psc.state.oh.us. An electronic version of the Application can be found on the OPSB website, <https://www.opsb.ohio.gov/>, by searching Case Number 19-1822-EL-BLN. Project information and how to request a copy of the Application can be found on DPL's website: <https://www.dpandl.com/About-DPL/Reliability/Transmission-Improvements/>.

The Project has been assigned Case number 1822-EL-BLN and the LON to construct, operate, and maintain the Project is now pending before the OPSB.

In accordance with OAC Rule 4906-6-08(A)(6), please be advised that interested persons may file motions to intervene and/or file comments with the OPSB within 10 days of the date of the publication of the public notice of the filing of this Project with the OPSB, as required by OAC Rule 4906-2-12, or later if good cause is shown. Petitions to intervene and comments should be addressed to the Ohio Power Siting Board, 180 East Broad Street, Columbus, Ohio 43215-3793 and reference Case No. 19-1822-EL-BLN. Please contact Scott Teeters at 937-331-4314 or by email at dptransmission-maintenancegroup@aes.com if you have any questions about the project.

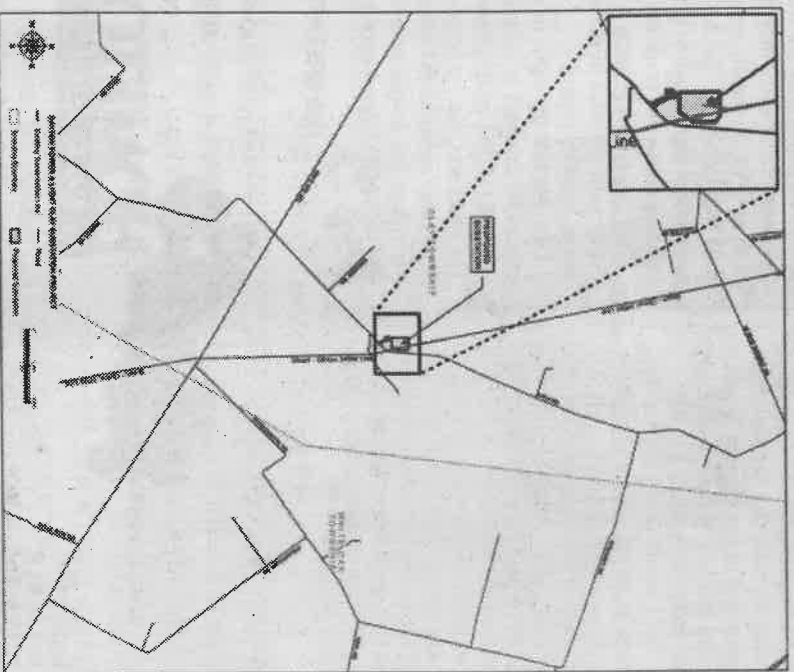

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

11/21/2019 3:13:09 PM

in

Case No(s). 19-1822-EL-BLN

Summary: Notification of Proof of Compliance with Ohio Administrative Code 4906-6-08 electronically filed by Mrs. Jessica E Kellie on behalf of The Dayton Power and Light Company