

May 20, 2021

Ms. Tanowa Troupe, Secretary
Ohio Power Siting Board
Docketing Division
180 East Broad Street, 11th Floor
Columbus, Ohio 43215-3797

Re: Case No. 20-1362-EL-BGN - In the Matter of the Application of Clearview Solar I, LLC for a Certificate of Environmental Compatibility and Public Need to Construct a Solar-Powered Electric Generation Facility in Champaign County, Ohio.

Third Supplemental Response to First Data Request from Staff of the Ohio Power Siting Board

Dear Ms. Troupe:

Attached please find Clearview Solar I, LLC's ("Applicant") Third Supplemental Response to the First Data Request from the staff of the Ohio Power Siting Board ("OPSB Staff"). The Applicant provided this response to OPSB Staff on May 20, 2021.

We are available, at your convenience, to answer any questions you may have.

Respectfully submitted,

/s/ Christine M.T. Pirik

Christine M.T. Pirik (0029759)

William V. Vorys (0093479)

Matthew C. McDonnell (0090164)

Dickinson Wright PLLC

150 East Gay Street, Suite 2400

Columbus, Ohio 43215

Phone: (614) 591-5461

Email: cpirik@dickinsonwright.com

wvorys@dickinsonwright.com

mmcdonnell@dickinsonwright.com

Attorneys for Clearview Solar I, LLC

Cc: Theresa White
Randall Schumacher
Jon Pawley
Andrew Conway

Ms. Tanowa Troupe
Clearview Solar I, LLC
Case No. 20-1362-EL-BGN

Page 2

CERTIFICATE OF SERVICE

The Ohio Power Siting Board's e-filing system will electronically serve notice of the filing of this document on the parties referenced in the service list of the docket card who have electronically subscribed to these cases. In addition, the undersigned certifies that a copy of the foregoing document is also being served upon the persons below this 20th day of May, 2021.

/s/ Christine M.T. Pirik

Christine M.T. Pirik (0029759)

Counsel:

jodi.bair@ohioattorneygeneral.gov
kyle.kern@ohioattorneygeneral.gov
jnapier@champaignprosecutor.org
cendsley@ofbf.org
lcurtis@ofbf.org
amilam@ofbf.org

Administrative Law Judge via email:

david.hicks@puco.ohio.gov

4842-4129-4570 v1 [85890-4]

**BEFORE
THE OHIO POWER SITING BOARD**

In the Matter of the Application of Clearview Solar)	
I, LLC for a Certificate of Environmental)	
Compatibility and Public Need to Construct a Solar-)	Case No: 20-1362-EL-BGN
Powered Electric Generation Facility in Champaign)	
County, Ohio.)	

**CLEARVIEW SOLAR I, LLC 'S
THIRD SUPPLEMENTAL RESPONSE TO THE FIRST DATA REQUEST
FROM THE STAFF OF THE OHIO POWER SITING BOARD**

On December 18, 2020, Clearview Solar I, LLC (“Applicant”), filed an application (“Application”) with the Ohio Power Siting Board (“OPSB”) proposing to construct a solar-powered electric generation facility in Champaign County, Ohio.

On February 2, 2021, the Staff of the OPSB (“OPSB Staff”) provided the Applicant with OPSB Staff’s First Data Request. Now comes the Applicant providing the following Third Supplemental Response to the First Data Request from the OPSB Staff regarding Question 3.

Question 3: Please update Figure 2 (Map of Aerial View of Project Area) to reflect the location of the 138 kV gen-tie line and provide associated shapefiles.

Response: Attachment 1 to this response is a map that shows the preliminary location of: (1) the construction area for the Project’s substation (“Substation”); (2) the construction area for the interconnecting utility’s substation (“Utility Substation”); and (3) the path of the 138 kilovolt (“kV”) gen-tie (“Gen-tie”) that will connect the two facilities and deliver the power from the Substation to the Utility Substation. The preliminary design of the Gen-tie is for a span of overhead electric line (single circuit, three phase) and associated fiber optic lines between approximately 100 and 200 feet in length. (The Gen-tie is shown on the map at approximately 200 feet.) The precise location and length of the Gen-tie will not be available until after the completion of the PJM-managed Facilities Study and associated location of the dead-end structure at the Utility Substation, final sign-off by the interconnecting utility, and completion of the final design and engineering of the Project. This preliminary design, however, provides the location of the Gen-tie with sufficient detail to assess its maximum impacts relative to the public and the environment.

The Applicant will provide the precise location of the Gen-tie, as well as all other facility components, to OPSB Staff prior to the start of construction of the Project.

Respectfully submitted,

/s/ Christine M.T. Pirik

Christine M.T. Pirik (0029759)

William V. Vorys (0093479)

Matthew C. McDonnell (0090164)

Dickinson Wright PLLC

150 East Gay Street, Suite 2400

Columbus, Ohio 43215


Phone: (614) 591-5461

Email: cpirik@dickinsonwright.com

wvorys@dickinsonwright.com

mmcdonnell@dickinsonwright.com

Attorneys for Clearview Solar I, LLC

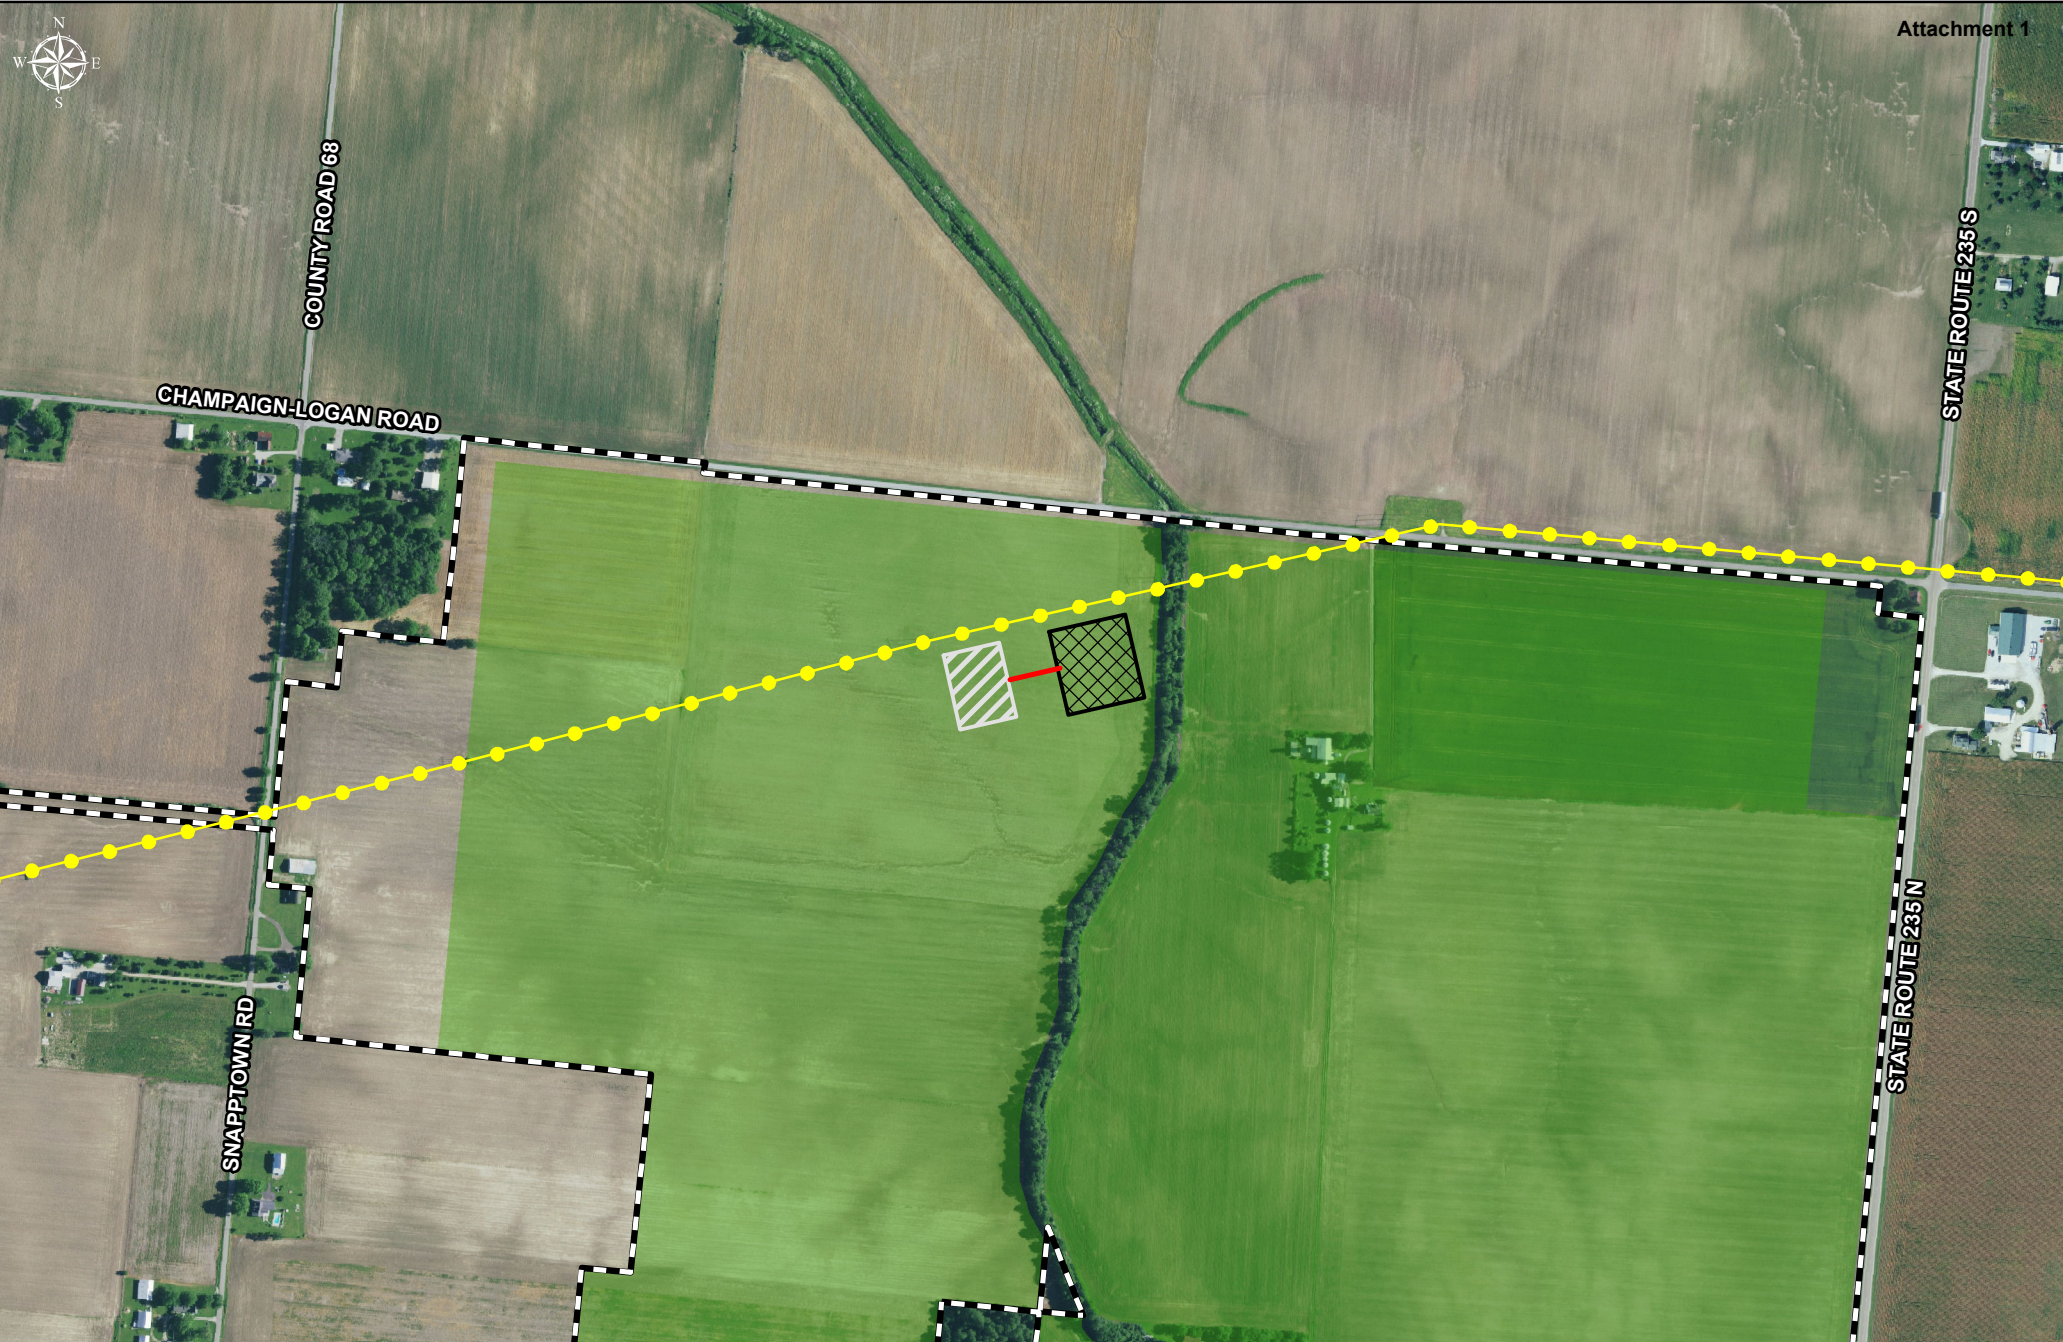

Clearview Solar I, LLC - Preliminary Substation Configuration

Date: May 20, 2021

Map Scale 1:7,500

Spatial Ref.: NAD 1983 2011 StatePlane Ohio North FIPS 3401 Ft US

0 600 1,200 2,400 Feet



- Preliminary Gen-Tie Line
- Existing 138kV Transmission Line
- X Preliminary Utility Substation
- / Preliminary Collection Substation
- Project Area
- Buildable Area

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

5/20/2021 3:06:25 PM

in

Case No(s). 20-1362-EL-BGN

Summary: Response - Third Supplemental Response to First Data Request from Staff of the Ohio Power Siting Board electronically filed by Christine M.T. Pirik on behalf of Clearview Solar I, LLC