

Legal Department

American Electric Power  
1 Riverside Plaza  
Columbus, OH 43215-2373  
AEP.com

October 10, 2022

Ms. Tanowa Troupe, Secretary  
Ohio Power Siting Board  
180 East Broad Street  
Columbus, Ohio 43215-3793

**Hector Garcia**  
Senior Counsel –  
Regulatory Services  
(614) 716-3410 (P)  
[hgarcia1@aep.com](mailto:hgarcia1@aep.com)

**RE: Case No. 22-0752-EL-BLN  
Lee Extension 138 kV Transmission Line Project  
Notice of Adjustment**

Dear Ms. Troupe:

After consulting with OPSB Staff, AEP Ohio Transmission Company, Inc. (the “Company”) provides the following notice of adjustment to the above referenced project.

The Company determined that the transmission line route shown on Figure 2 in the Company’s filing on August 5, 2022 needs to be adjusted due to construction impacts to the Ohio Department of Transportation’s (ODOT) drainage swell. The Company determined that Structure 7 would need to be shifted 8.6’ north, within the proposed right-of-way, to avoid impacts to the ODOT drainage swell, see attached exhibit. However, the application text remains unchanged based on the proposed shift and does not affect any new property owners, impact any additional wetlands or streams, or require additional tree clearing. Attached is an exhibit (Lee 138 kV Extension – STR 7 Shift Exhibit) showing the proposed Structure 7 shift. The Company will also provide updated shape files prior to the start of construction.


If you have any questions, please do not hesitate to contact me.

Respectfully submitted,

/s/ Hector Garcia

Hector Garcia (0084517), Counsel of Record  
Counsel for AEP Ohio Transmission Company, Inc.

cc: John Jones, Counsel OPSB Staff  
Jon Pawley, OPSB Staff

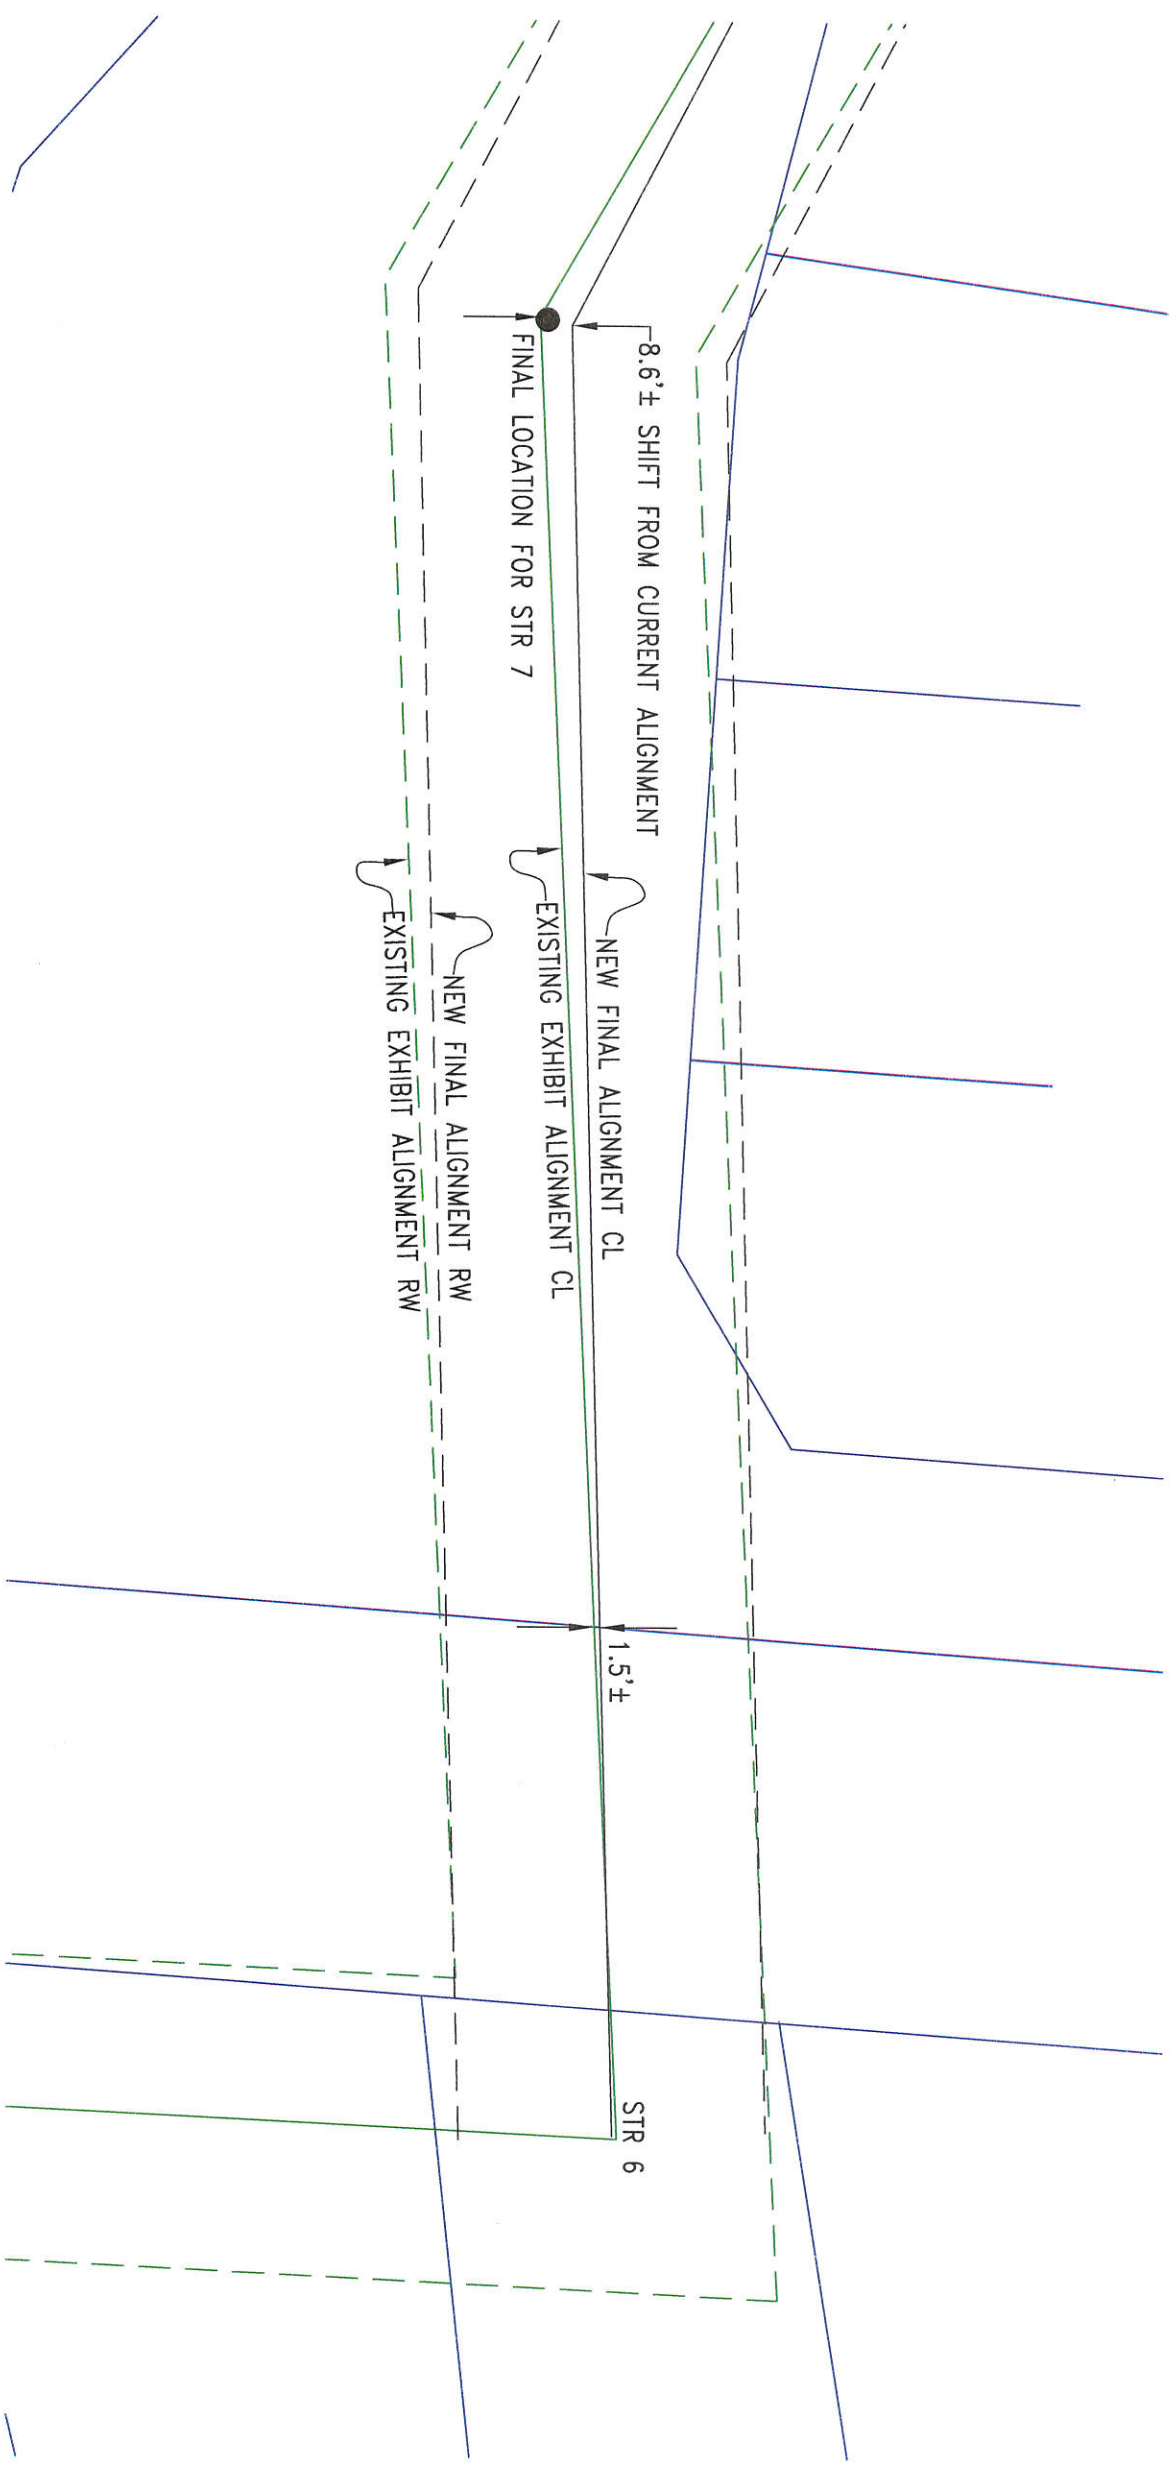

8.6'± SHIFT FROM CURRENT ALIGNMENT

FINAL LOCATION FOR STR 7

NEW FINAL ALIGNMENT CL

EXISTING EXHIBIT ALIGNMENT CL

NEW FINAL ALIGNMENT RW

EXISTING EXHIBIT ALIGNMENT RW

1.5'±

STR 6





**This foregoing document was electronically filed with the Public Utilities  
Commission of Ohio Docketing Information System on**

**10/10/2022 3:39:46 PM**

**in**

**Case No(s). 22-0752-EL-BLN**

Summary: Notice Of Adjustment Lee Extension Project electronically filed by  
Hector Garcia-Santana on behalf of AEP Ohio Transmission Company, Inc.